







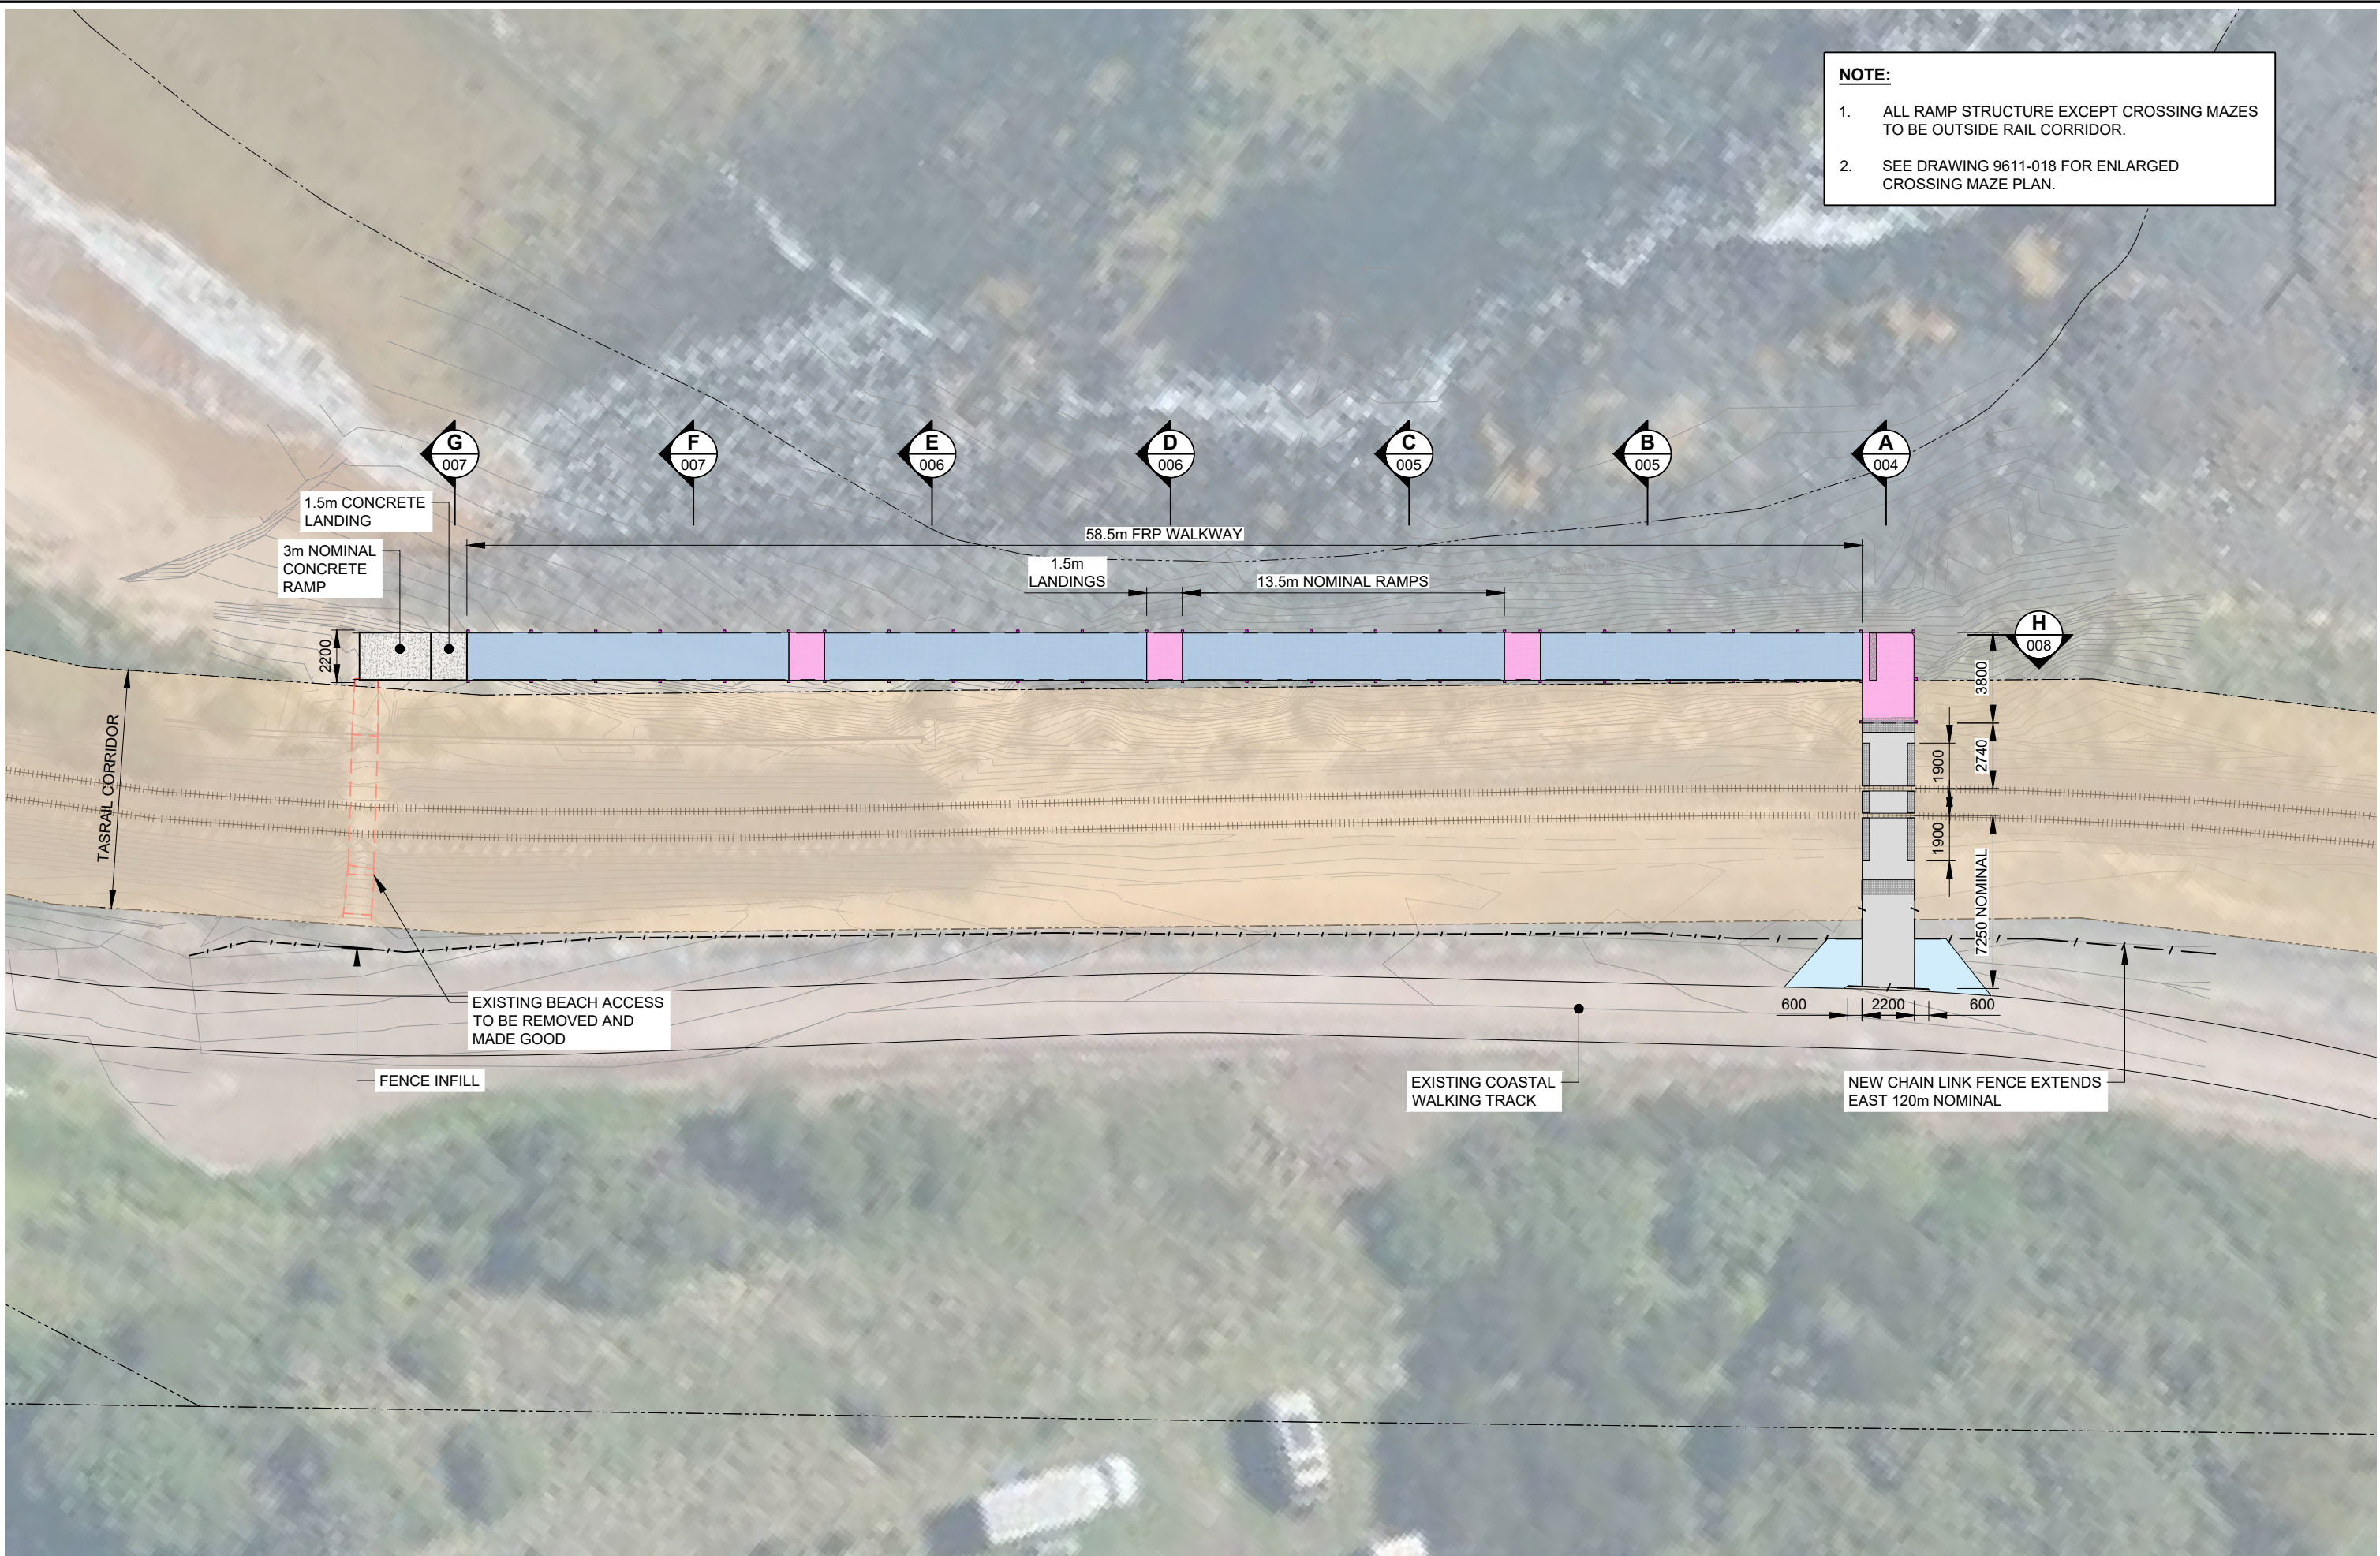

NOTE:


1. ALL RAMP STRUCTURE EXCEPT CROSSING MAZES TO BE OUTSIDE RAIL CORRIDOR.
2. SEE DRAWING 9611-018 FOR ENLARGED CROSSING MAZE PLAN.

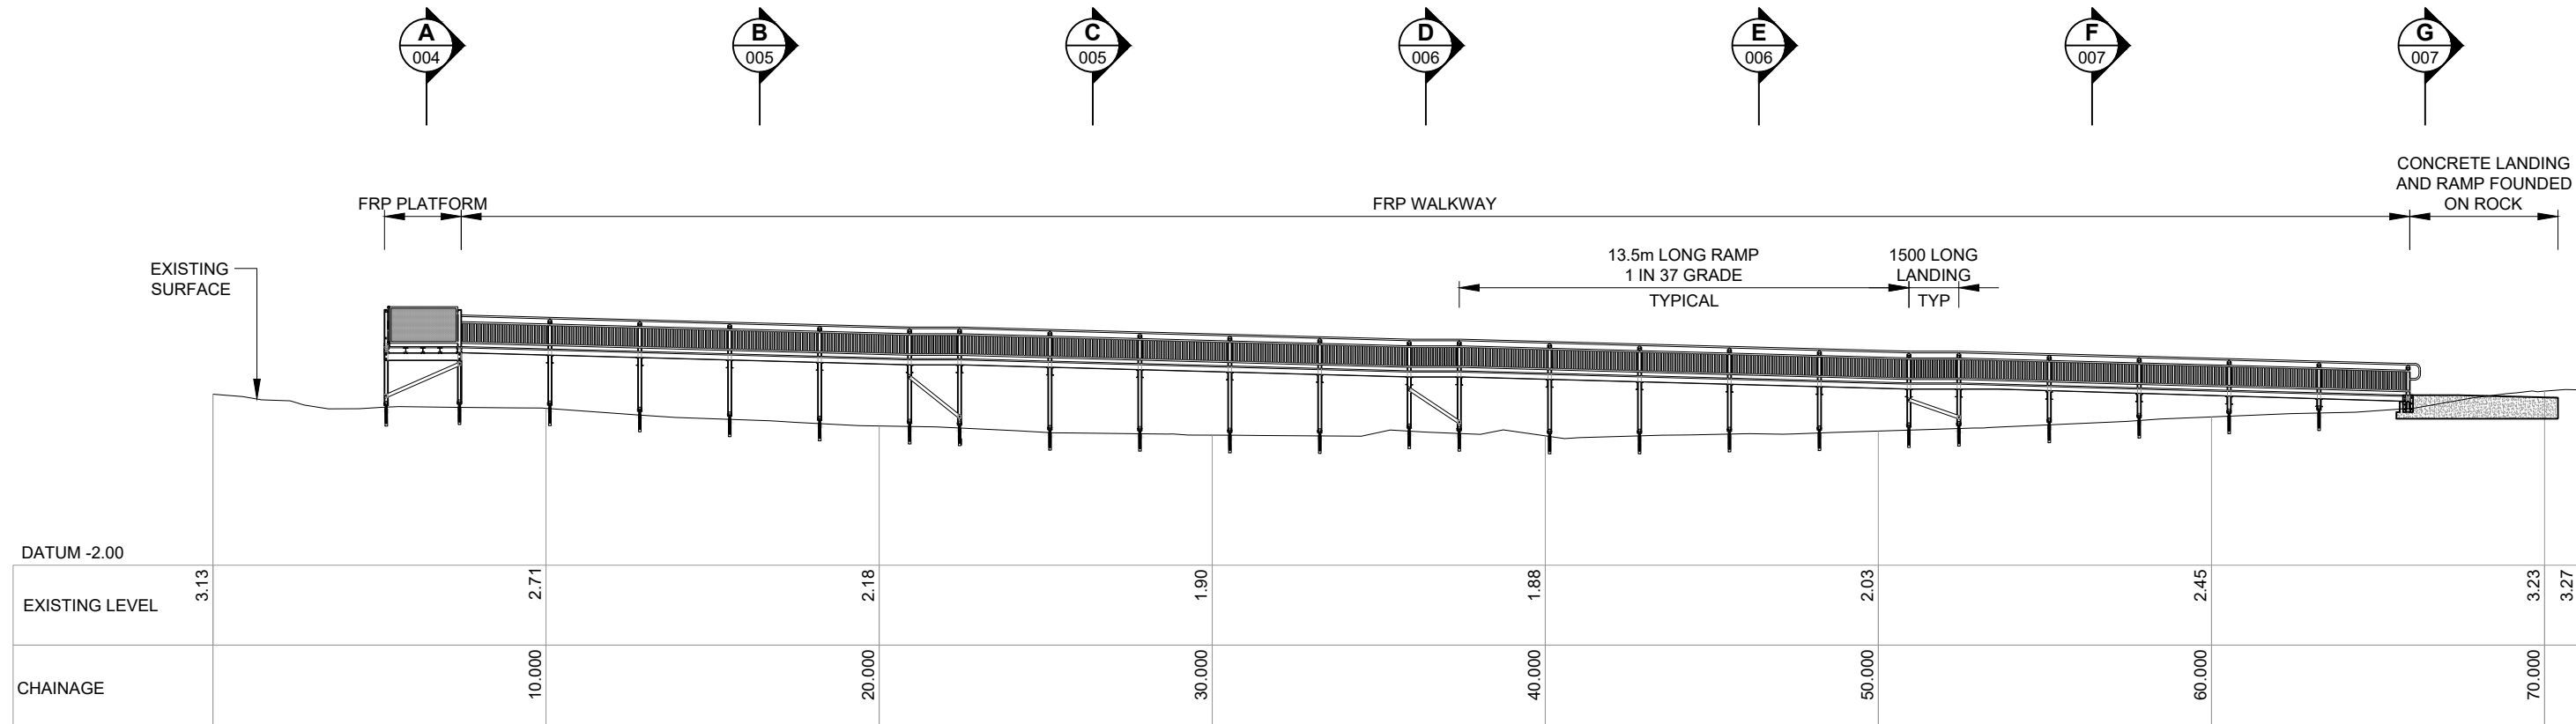

SECTION H

NOTES:

1. ALL INTERMEDIATE TRESTLES TO BE BRACED
LATERALLY WITH A MINIMUM OF ONE DIAGONAL
BR1 MEMBER.

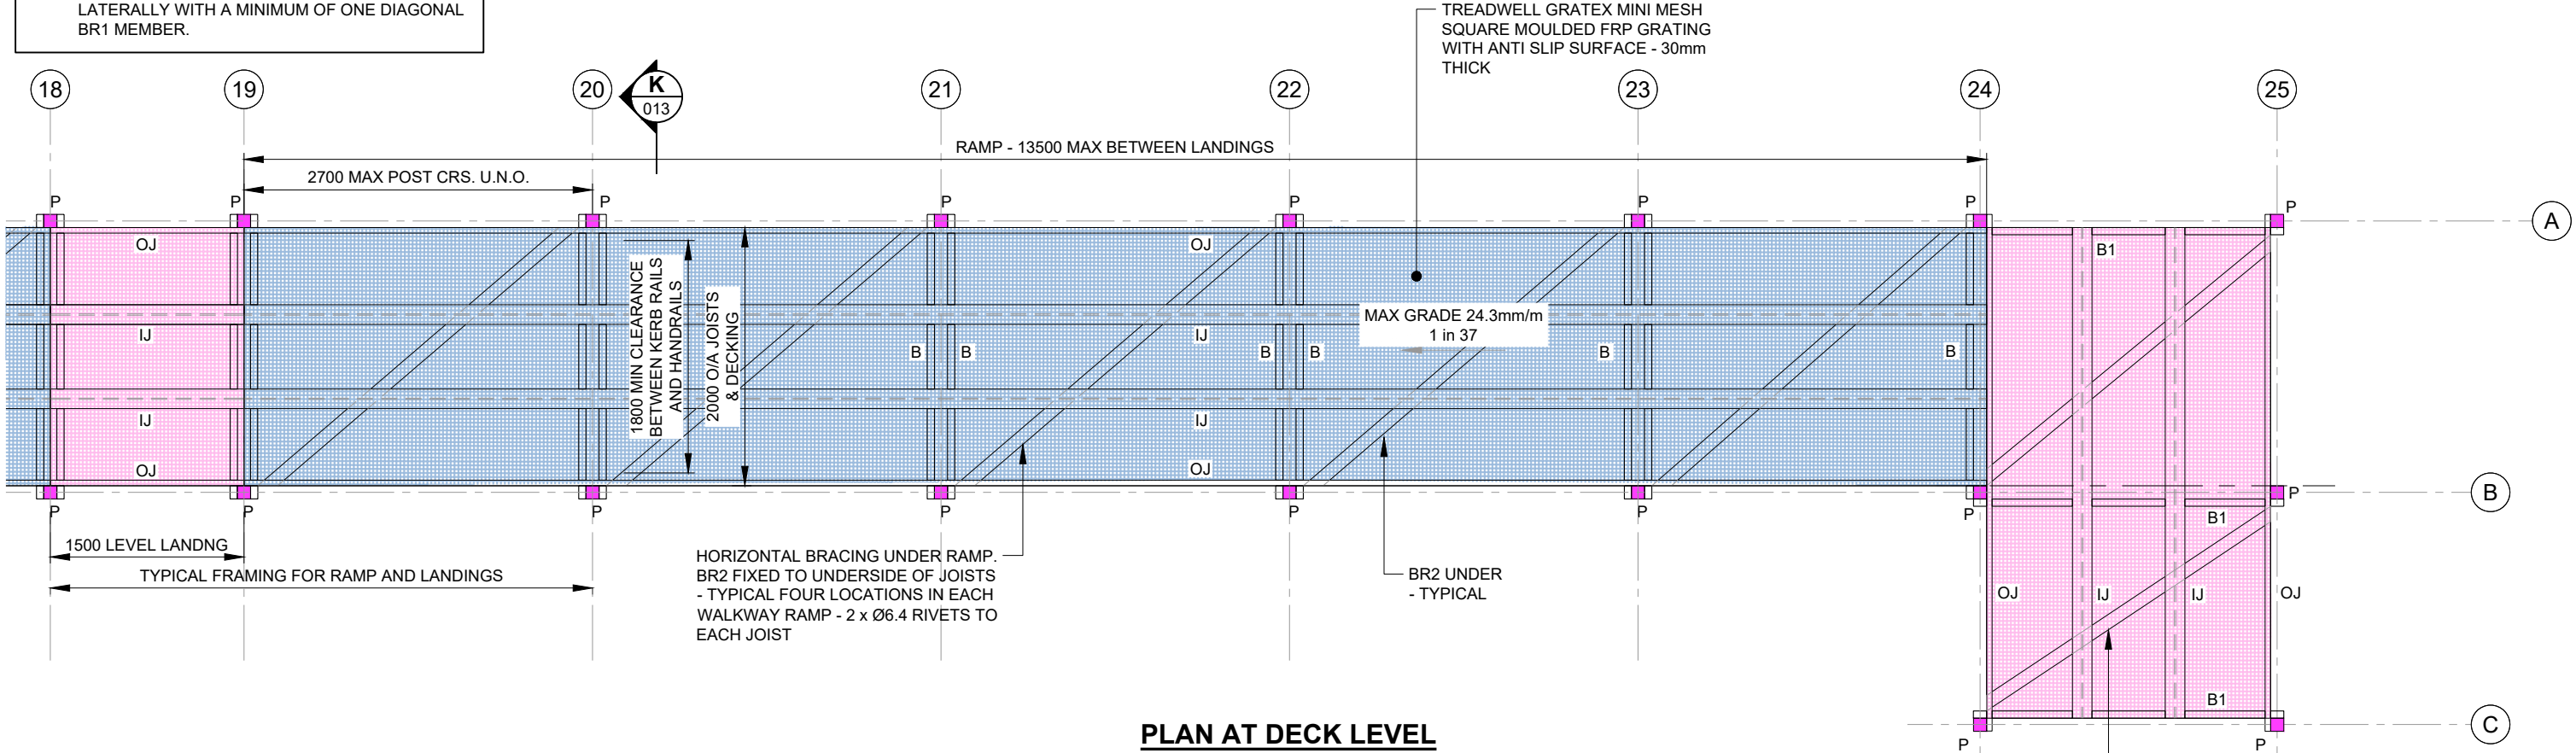

PLAN AT DECK LEVEL


FOOTINGS:

A - MINIMUM SIZE

- F1 - Ø400 x 1.3m DEEP BELOW ORIGINAL SURFACE LEVEL
- WHERE THE EXISTING SURFACE LEVEL IS EXCAVATED TO SUIT THE WALKWAY FRAMING THE MINIMUM FINISHED CONCRETE DEPTH IS TO BE 1m

B - ROCK

WHERE SOLID ROCK IS ENCOUNTERED ABOVE THE LEVEL OF THE FOOTING BASE, THE FOOTING IS TO BE INCREASED TO Ø600 AND THE CONCRETE PINNED TO THE ROCK USING TWO GALVANISED N16 BARS EACH 500 LONG, DRILLED AND GROUTED 200 INTO THE ROCK

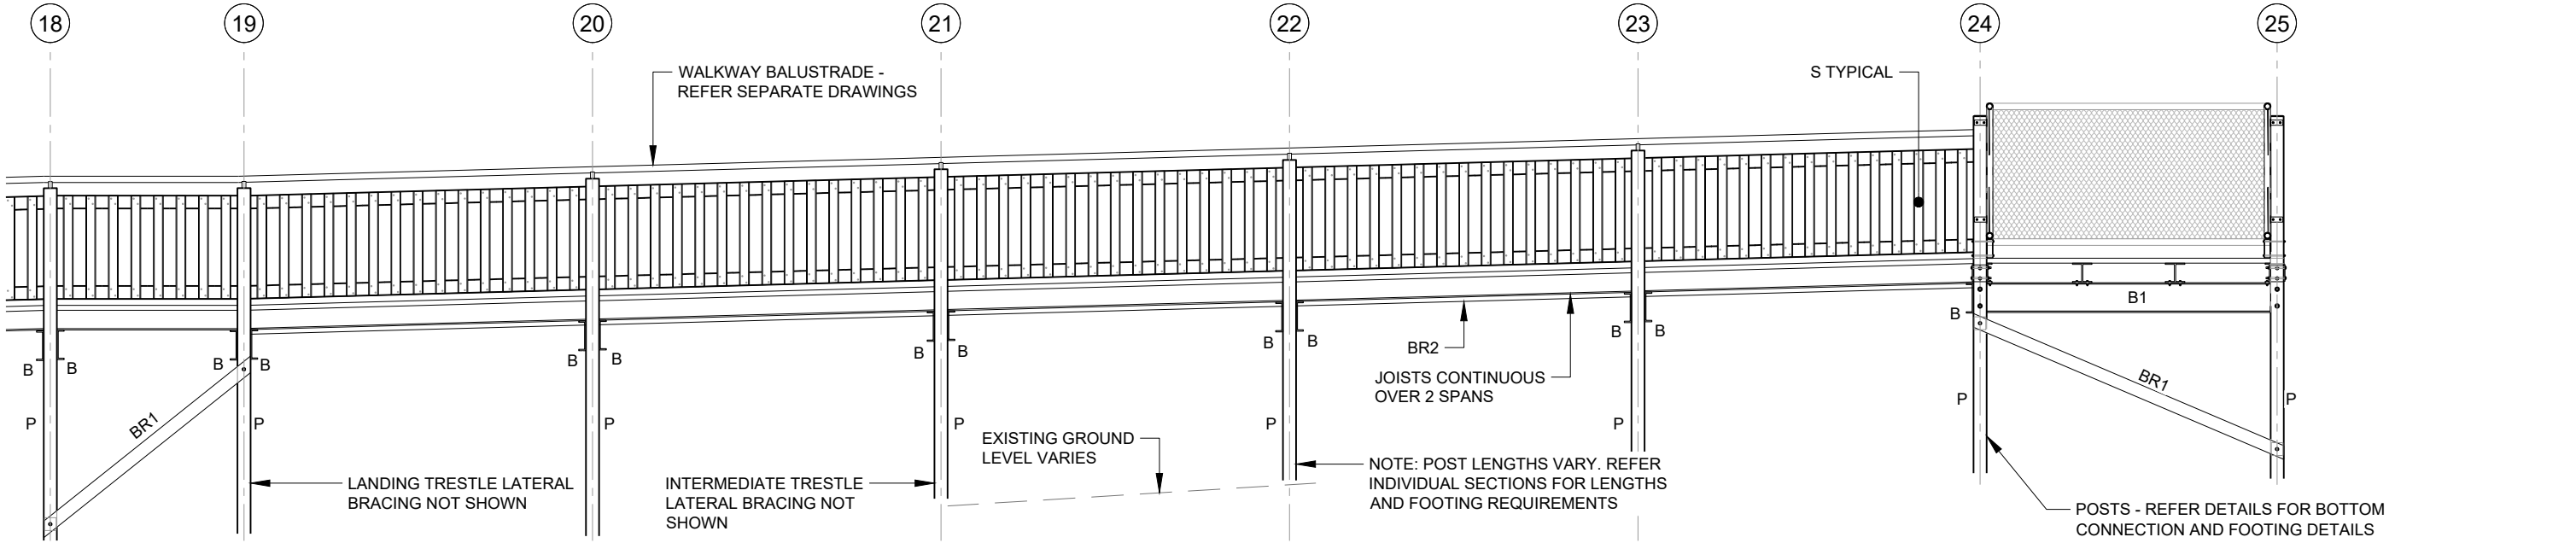

ELEVATION

Issue:	Date:	Description:	Checked	Approved
P2	20-06-23	ISSUED FOR REVIEW	-	-
P2	20-06-23	ISSUED FOR REVIEW	L.N.T.	L.N.T.
C1	03-03-25	ISSUED FOR CONSTRUCTION	L.N.T.	L.N.T.